


IMPORTANT NOTICE TO ELECTRICIAN:

THIS SYSTEM WILL NOT OPERATE PROPERLY WITHOUT A DEDICATED "CONTROL" CIRCUIT AND TWO FIRE SUPPRESSION MICRO SWITCHES.

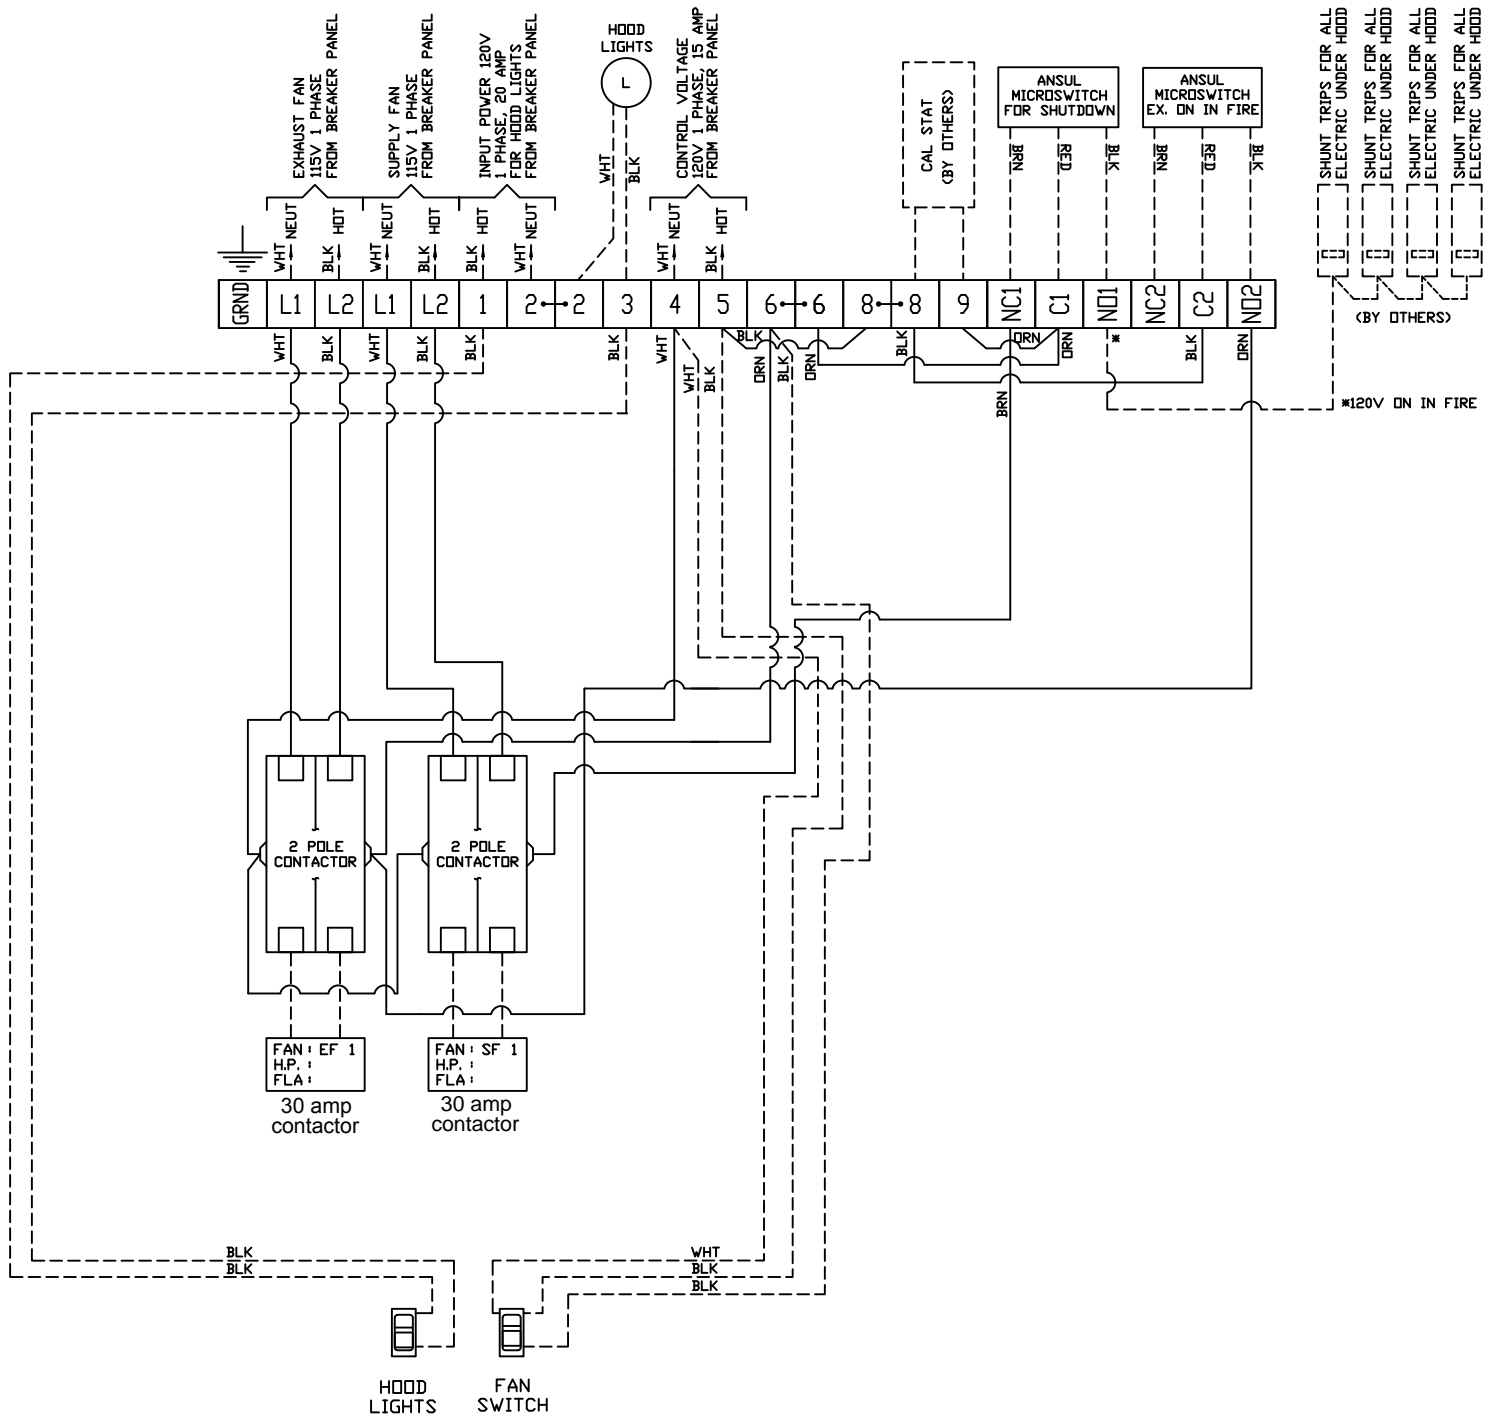

- TERMINAL JUMPER
- FACTORY WIRING
- - - FIELD WIRING
- ⏏ EQUIP. GROUND

PDI PART # 40-ELEC2