




Model: EOBR

Exhaust Only Back Return

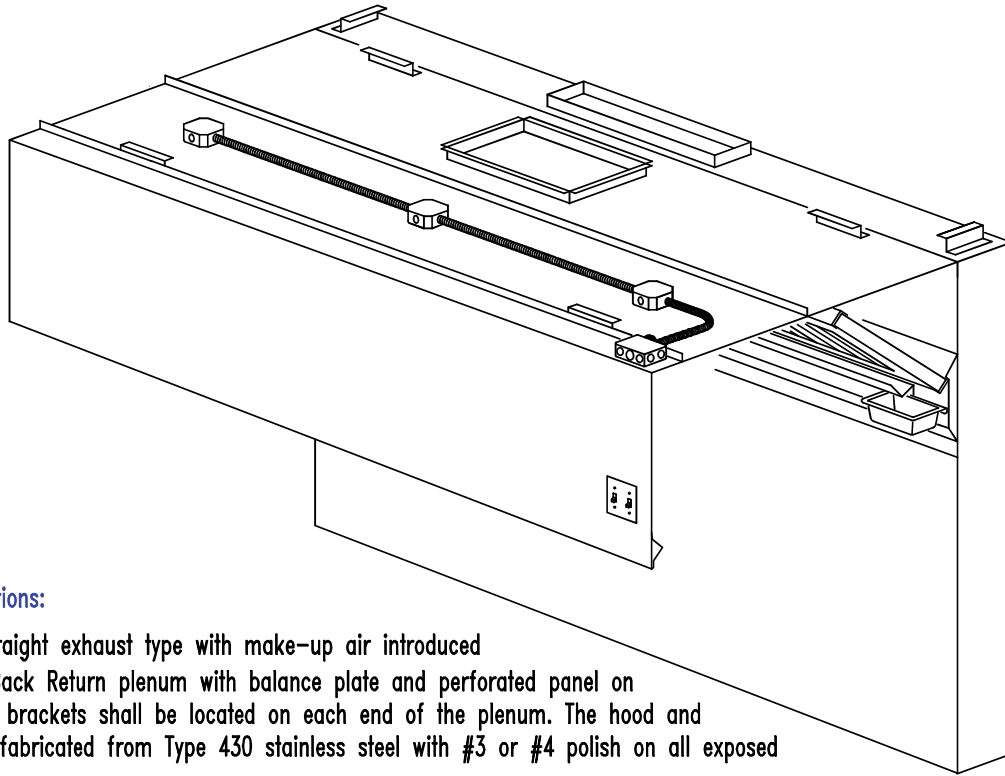

General Specifications:

Hood shall be straight exhaust type with make-up air introduced through a (BR) Back Return plenum with balance plate and perforated panel on bottom. Mounting brackets shall be located on each end of the plenum. The hood and plenum shall be fabricated from Type 430 stainless steel with #3 or #4 polish on all exposed surfaces.

Hood shall be of double wall construction with seams and joints welded and sealed liquid tight, to conform to NFPA 96. Corners of hood shall be trimmed to give the hood a straight, crisp appearance free of warps. 12 gauge hanging brackets for hood shall be located on each corner (more brackets as needed for longer hoods.) Grease filters shall be UL classified, non-clogging, baffle type. Filter size and quantity to extend the full length of hood and shall be easily removable for cleaning purposes.

All exhaust plenum surfaces and filters shall drain into a removable grease trough and be conveyed to a removable grease container for easy cleaning. Incandescent lights shall be installed at approximately 3' intervals and shall be UL listed for use in exhaust hoods and allow up to a 100 Watt standard light bulb. Lights shall be completely pre-wired to a junction box located on top of the hood. Exhaust collar shall have a 3/4" welding flange for easy field connection. Supply collar shall be provided.

Complete computer generated submittal drawings including material type, hood section view(s), plan view(s) and options chosen shall be provided. Duct sizes, CFM requirements and static pressures shall be shown on drawings. The hood shall be constructed in accordance with NFPA 96, bear the NSF Seal of Approval, and be ETL Listed. Hood and Plenum to be manufactured by Peachtree Distributing Inc. (404) 351-6442

Optional Features:

- Electrical controls/ Auto Fan Control System
- Fire protection system
- Utility cabinet/ Fire cabinet
- Enclosure panels
- End panels

